



SMOKE GUARD® system

Model 2100

Vertical Opening Protective



System Description. The Smoke Guard system **Model 2100 opening protective (M2100)** is a code compliant curtain assembly that is designed to protect openings. The **M2100** consists of a high performance fabric curtain assembly (specifiable as smoke only or fire + smoke-rated) mounted within a steel housing. The curtain is captured vertically by a side guide assembly on both sides of the curtain. The curtain is equipped with a bottom bar to seal the curtain at the floors. **M2100** comes in a standard galvanized finish. RAL color options are available or may be field painted to spec.

Dimensions

- Openings: $\leq 16'$ wide by $\leq 12'$ tall
- Housing height: $6 \frac{3}{8}"$
- Housing depth: $6 \frac{1}{4}"$

Standards

- NFPA 105 "Installation of Smoke Control Door Assemblies"
- NFPA 80 "Standards for Fire Doors and Other Opening Protectives"
- NFPA 252 "Standard Methods of Fire Tests of Door Assemblies" (20 minute) listed by Intertek
- UL 10B "Fire Tests of Door Assemblies" (20 minute without hose stream) listed by Intertek
- UL 10C "Positive Pressure Fire Tests of Door Assemblies" (20 minute without hose stream) listed by Intertek
- UL 10D "Fire Tests for Fire Protective Curtains" (2 hours) listed by Intertek
- UL 864 "Control Units for Fire Protective Signaling Systems" listed by Intertek
- UL 1784 "Air Leakage Tests of Door Assemblies" listed by Intertek

Code References


- 2009/2012/2015/2018/2021 IBC Section 909
- 2009/2012/2015 IBC Section 716.5.3
- 2018/2021 IBC Section 716.2.2.1

Codes and Standards. **M2100** fulfills IBC requirements to provide an opening protective, where these assemblies are permitted as passive barriers used in conjunction with smoke control systems. This fire + smoke-rated curtain system can serve as an opening protective for counter tops, openings in fire-rated corridors, and applications in atrium construction.





Model 2100 Vertical Opening Protective

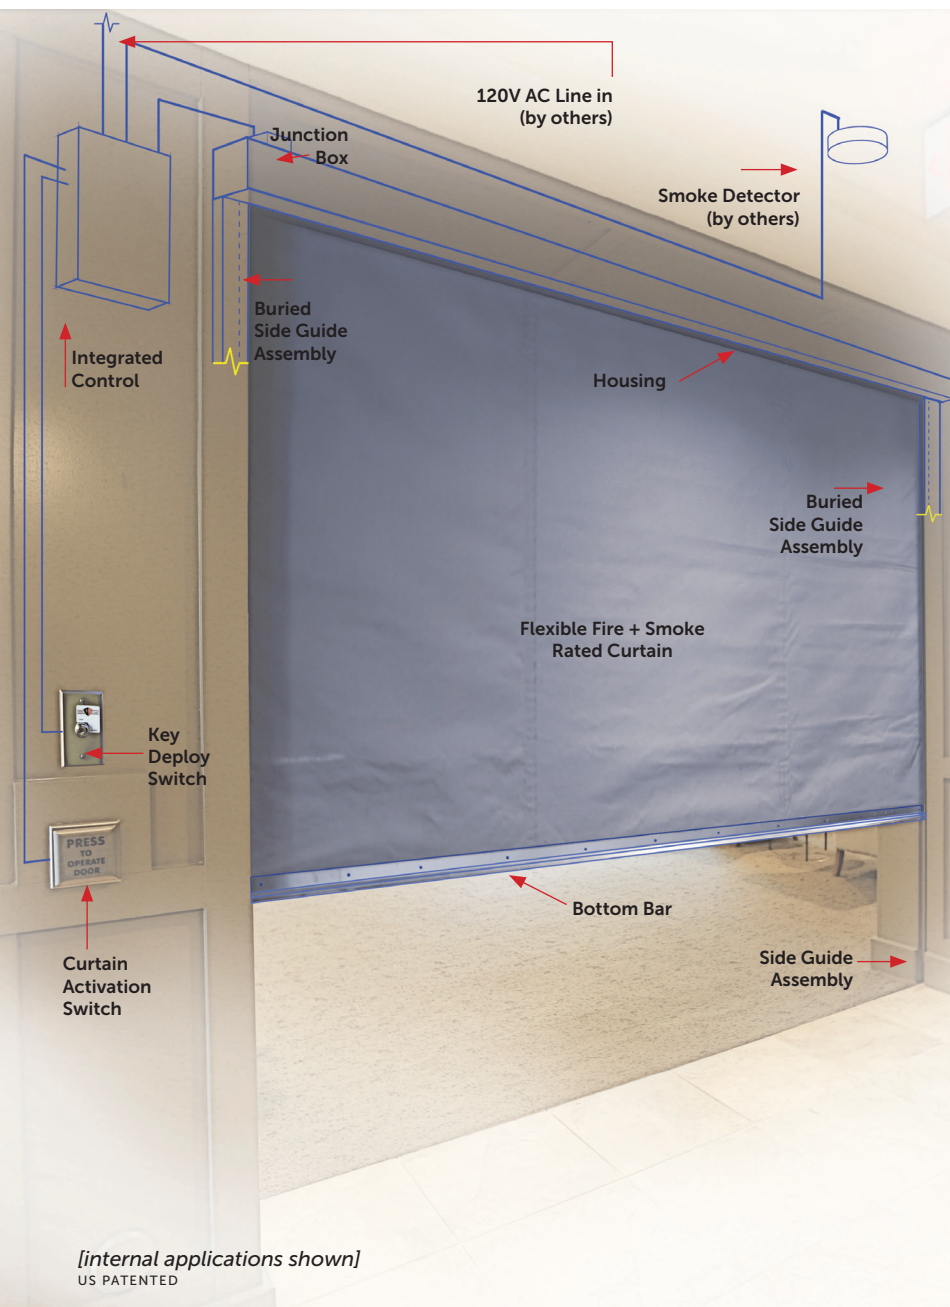

System Operation. The system is deployed on an alarm signal from the local smoke detector or from a fire control panel. System power requirement is 120-volt AC. The unit is also equipped with a 24-volt DC battery back-up system that is maintained by the electronic controls. When required, the system can also be connected to building standby power. The controls include a universal power supply that can be adapted to foreign electrical current requirements.

Installation. The system is typically mounted above the ceiling, anchoring above or on to a header assembly supported from the deck above. It may also be mounted to a wall. The side guides are secured to the wall on either side of the opening and may be surface mounted or embedded for smooth finish walls. All Smoke Guard system units are installed by factory recognized installation personnel. Preparation work required by others is outlined in the product specification. Installation requires clear, plumb, unobstructed wall surfaces for mounting the side guides, 120v AC power and, should local smoke detection be required, a smoke detector.

Smoke Guard and Your Project

- ☐ Check for clearance/obstructions issues on, above, and surrounding the opening (sprinklers, HVAC, etc.)
- ☐ Field verify opening measurements prior to ordering systems
- ☐ Available 120 VAC circuit with 7 amp capacity per controller
- ☐ Fire alarm system has normally open auxiliary contacts available
- ☐ Confirm suitable backing for housing and guides

Fail Safe Features. The M2100 is a gravity fail safe system. The M2100 also features a fault report to indicate that the system requires a corrective action. The control unit monitors the state of curtain deployment.

Releasing Device. The M2100 control has been tested in accordance with the UL 864 standard and listed by Intertek Labs.

Screen Options. Upgrades such as an on-screen curtain retraction switch and bottom bar edge sensor may be added to system when configuring. Consult your local SG representative.

FSCS Option. The interface for Firefighter Smoke Control Station (FSCS) provides high priority inputs to remotely OPEN and CLOSE curtain.

Curtain Activation Switch. The curtain activation switch may be mounted on opposite sides of the opening. If the system remains in alarm, and the curtain activation switch is engaged, the system will retract to allow passage and then redeploy after a brief pause. When the alarm clears the curtain automatically retracts to the ready position.