

SMOKE GUARD® system

Model 2100

Vertical Fire + Smoke Curtains

System Description. The Smoke Guard System Model 2100 is offered in both smoke-rated and fire-rated configurations (M2100|smoke and M2100|fire). These code compliant assemblies are designed to protect openings as part of a smoke control system. The M2100 consists of a smoke only or fire-rated textile curtain assembly mounted within a steel housing. The curtain is captured vertically on both sides by a side guide assembly. The curtain assembly is equipped with a bottom bar to seal the curtain at the bottom. Standard housing and side guide finish is galvanized, RAL colors available at an additional charge.

Dimensions

- Openings: ≤ 16' wide by ≤ 12' tall
- Housing height: 6.25"
- · Housing depth: 6"

Standards

- UL 10B "Fire Tests of Door Assemblies" (20 min. without hose stream) listed by Intertek (fire-rated assemblies)
- UL 10C "Positive Pressure Fire Tests of Door Assemblies" (20 min. without hose stream) listed by Intertek (fire-rated assemblies)
- UL 10D "Fire Tests for Fire Protective Curtains" (2 hr.) listed by Intertek
- UL 864 "Control Units for Fire Protective Signaling Systems" listed by Intertek
- UL 1784 "Air Leakage Tests of Door Assemblies" listed by Intertek
- NFPA 105 "Installation of Smoke Control Door Assemblies"
- NFPA 252 "Standard Methods of Fire Tests of Door Assemblies" (20 minute)
- NFPA 80 Chapter 21

Code References

- 2012 IBC Section 909
- 2012/2015/2018 IBC Section 710.5.2 (smoke partitions)
- 2012/2015/2018 IBC Section 708.6 (fire partitions)

Codes and Standards. M2100 fulfills IBC requirements to provide an opening protective, where these assemblies are permitted as passive barriers used in conjunction with smoke control systems. This smoke or fire-rated curtain system can serve as an opening protective for counter top, openings in corridor, and certain applications in atrium construction.










Model 2100

Vertical Fire + Smoke Curtains

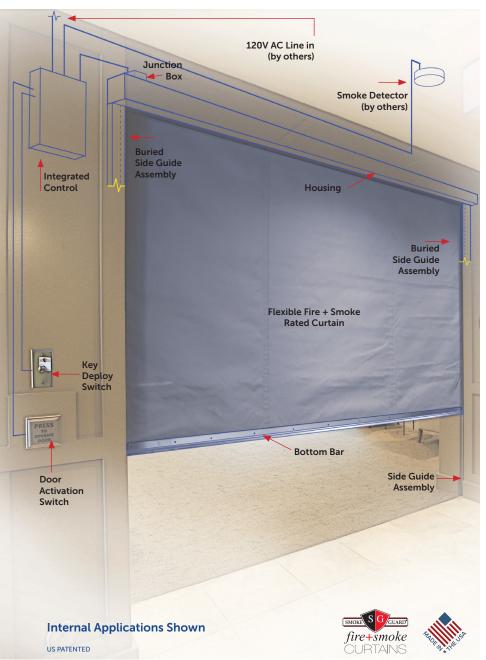

Fail Safe Features. The M2100 is a gravity fail safe system. The M2100 also features a fault report to indicate that the system requires a corrective action. The control unit monitors the state of curtain deployment.

Listed Releasing Device. The M2100 control has been tested in accordance with the UL 864 standard and listed by Intertek Laboratories.

System Operation. The system is deployed upon a signal from the local smoke detection system or from a smoke control panel, normally open dry contact initiates deployment. System power requirement is 120-volt AC. The unit is also equipped with a 24-volt DC battery backup system that is maintained by the electronic controls. When required the system can be connected to building standby power. The controls include a universal power supply that can be adapted to foreign electrical current requirements.

Installation. The system is typically mounted above the ceiling. It anchors to the ceiling above or on to a header assembly supported from the deck above. It may also be mounted to a wall. The side guides are secured to the walls on either side of the opening and may be embedded for smooth finish walls. All Smoke Guard system units are to be installed by factory recognized installation personnel. Preparation work required by others is outlined in the product specification. Installation requires clear, plumb, unobstructed wall surfaces for mounting side guides, housing, and AC power.

Smoke Guard and Your Project

Check for clearance/obstructions issues on, above, and surrounding the opening (sprinklers, HVAC, etc.)
Field verify opening measurements prior to ordering systems
Single motor units require a 120 VAC with a 10 amp circuit per unit
Install the system control in visual proximity of the unit for servicing ease
Provide a level and plumb smoke or fire-rated mounting surface to attach to per building code requirements

Door Activation Switch. The door activation switch may be mounted on opposite sides of the opening. If the system remains in alarm, and the door activation switch is engaged, the system will retract to allow passage and then redeploy after a brief pause. When the alarm clears the curtain automatically retracts to the ready position.